




Requirements for Loading Zones in Fire Lanes



Per the Local Amendments to the FFPC, Fire Lanes fronting a retail establishment may have Loading Zones. Each Loading Zone **shall not exceed** twenty-five (25') feet in length nor shall the combined loading zone footage exceed twenty (20%) percent of the building frontage. Loading Zones shall be located no closer than seventy-five (75') feet apart, with a maximum fifteen (15) minute time limit imposed.

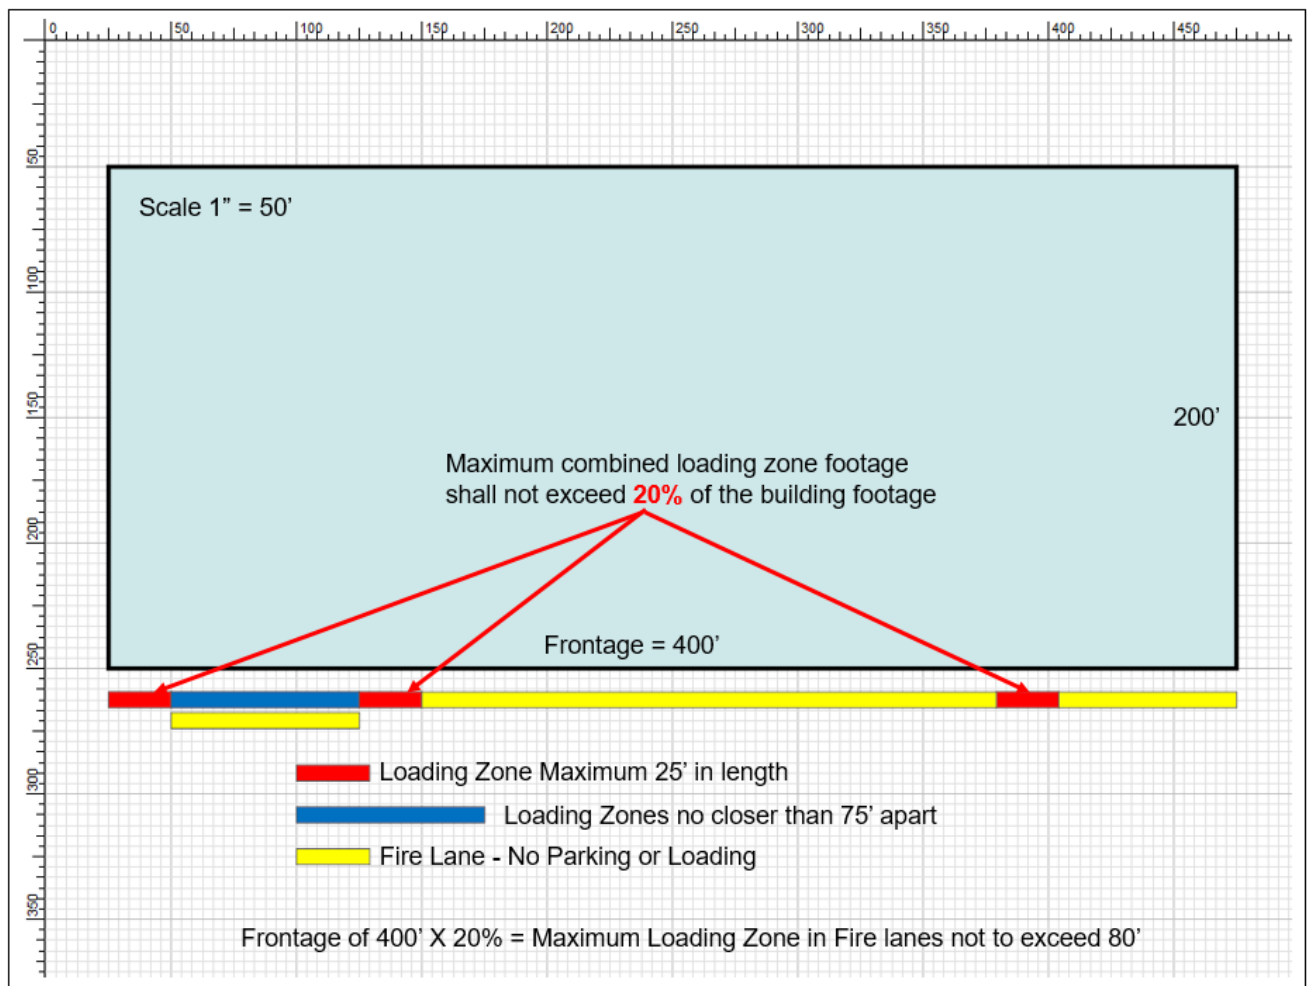

For more information on Fire Safety click here

CRRD

EXCELLENCE TODAY



IMPROVING TOMORROW